


# CONDUCTIVITY LEVEL PROBE APPLICATION - METAL TANK - ALARM

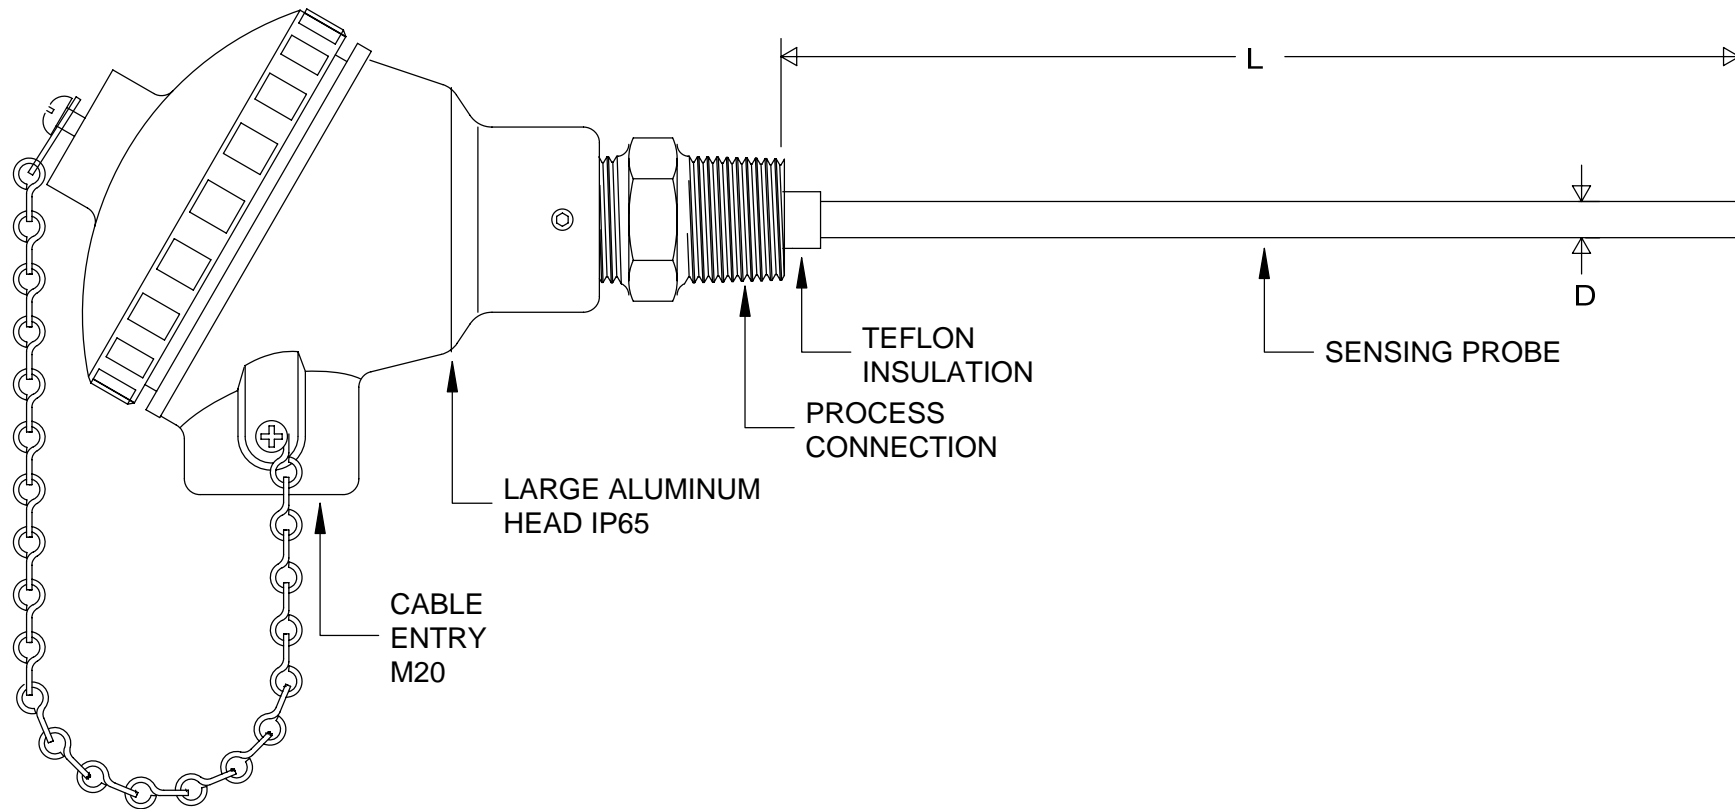

## PROCESS CAPABILITIES

- MUST BE USED WITH CONDUCTIVITY CONTROLLER
- PROBE DIA 1/8" OR 3/16" OR 1/4" 316 S/S STANDARD
- PROCESS CONNECTION: -1/2" BSP OR NPT STANDARD
  - 3/4" BSP OR NPT
  - 1" BSP OR NPT
- SUITABLE FOR UNPRESSURISED APPLICATIONS ONLY.
- FOR PRESSURE APPLICATIONS CONSULT THE FACTORY

**TEMPERATURE CONTROLS PTY LTD** Certificate No: QEC 14412  
AS/NZS 9001:2000

### CONDITIONS

THIS DRAWING IS OUR EXCLUSIVE PROPERTY AND MUST NOT BE COPIED OR HANDED TO ANY OTHER PARTIES WITH OUT WRITTEN PERMISSION. IT SHALL BE RETURNED UPON REQUEST

SYDNEY : 7 YAMMA ST SEFTON , NSW 2162  
PHONE : (02) 9721 8644 FAX : (02) 9738 9339  
MELBOURNE : 8/280 WHITEHALL ST  
YARRAVILLE VIC 3013  
PHONE : (03) 9687 0000 FAX : (03) 9687 1900  
EMAIL : sales@temperature.com.au



TITLE

SIZE : A4

DATE : 17/08/12

**DWG NO : SD 099**

SCALE : NTS

DRAWING BY R.B

**REV : 00**